


OCEANSAVE PLAN

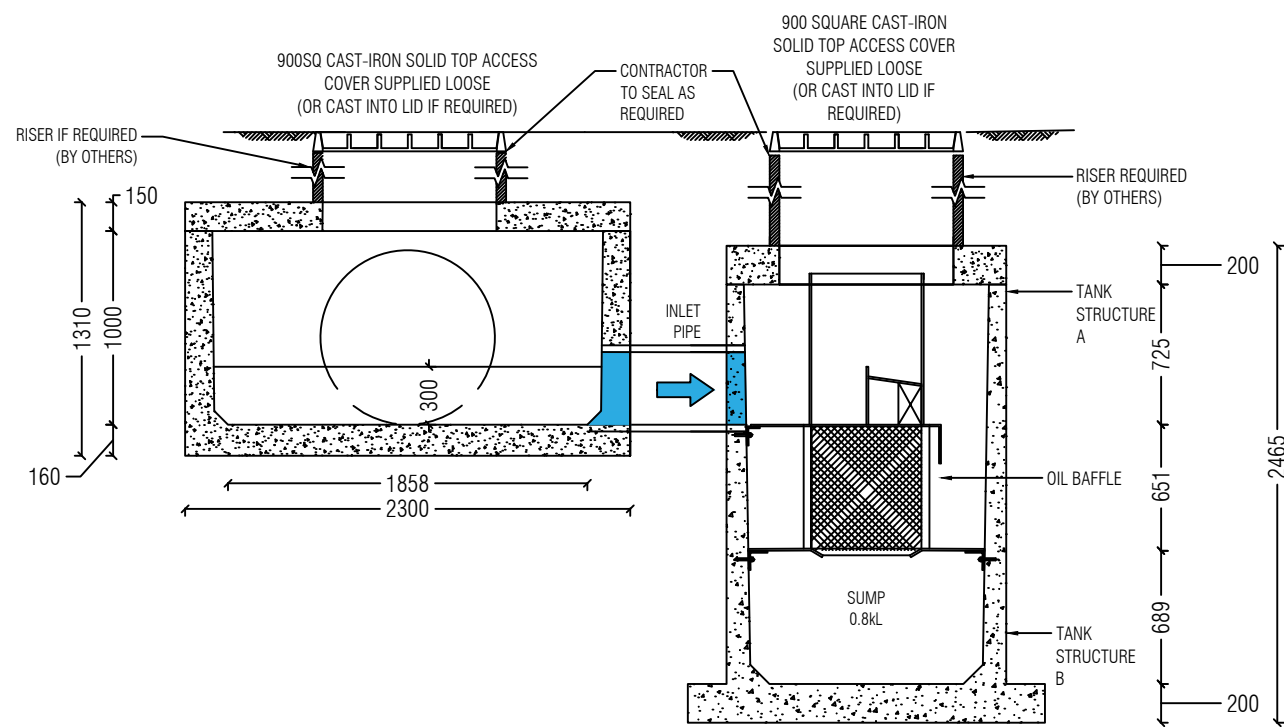

OCEANSAVE SECTION

OCEANSAVE DESIGN TABLE

TO BE INSTALLED ONLINE THE TOTAL INLET PIPE FLOW RATE MUST BE LESS THAN THE SPECIFIED UNITS LISTED MAXIMUM TOTAL FLOW RATE; THE UNIT MUST BE PLACED OFFLINE WHERE THE INLET FLOW RATE EXCEEDS THIS VALUE.

TREATABLE FLOWRATE [L/s]	28
MAXIMUM TOTAL FLOWRATE [L/s]	1048
WEIR HEIGHT [mm]	300

<div>C:\Users\nathan\Documents\Reversed 3D model.png</div>	SITE SPECIFIC DATA REQUIREMENTS			
	FLOWRATE INTO DIVERSION CHAMBER[L/S]			[]
	PIPE DATA:	I.L.	MATERIAL	DIAMETER
	INLET PIPE	[]	[]	[]
	OUTLET PIPE	[]	[]	[]
	DIVERSION UPPER TANK WEIGHT		4725kg	
	DIVERSION LOWER TANK WEIGHT		8567kg	
	UPPER TANK WEIGHT		770kg	
UPPER TANK WEIGHT		3552kg		

NOTE: TANK SUPPLIED IN TWO PARTS; PARTS A & B TO BE JOINED ON SITE

GENERAL NOTES

- OCEANSAVE WATER QUALITY STRUCTURE SHALL BE IN ACCORDANCE WITH ALL DESIGN DATA AND INFORMATION CONTAINED IN THIS DRAWING. CONTRACTOR TO CONFIRM STRUCTURE MEETS REQUIREMENTS OF THE PROJECT.
- PRECAST STRUCTURE SUPPLIED WITH CORE HOLES TO SUIT OUTER DIAMETER OF NOMINATED PIPE SIZE / MATERIAL.
- PRECAST STRUCTURE SHALL MEET W80 WHEEL LOAD RATING ASSUMING A MAXIMUM EARTH COVER OF 2.0m AND A GROUND WATER ELEVATION AT, OR BELOW, THE OUTLET PIPE INVERT ELEVATION. ENGINEER TO CONFIRM ACTUAL GROUNDWATER ELEVATION.PRECAST STRUCTURE SHALL BE IN ACCORDANCE WITH AS3600.
- ALL WATER QUALITY TREATMENT DEVICES REQUIRE PERIODIC MAINTENANCE. REFER TO OPERATION AND MAINTENANCE MANUAL FOR GUIDELINES AND ACCESS REQUIREMENTS.
- SITE SPECIFIC PRODUCTION DRAWING WILL BE PROVIDED ON PLACEMENT OF ORDER.
- DRAWING NOT TO SCALE.

INSTALLATION NOTES

- ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE SPECIFIC DESIGN CONSIDERATION AND SHALL BE SPECIFIED BY THE SITE CIVIL ENGINEER.
- CONTRACTOR TO PROVIDE ALL EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE STRUCTURE (LIFTING DETAIL PROVIDED SEPARATELY).
- CONTRACTOR TO INSTALL AND LEVEL THE STRUCTURE, APPLY SEALANT TO ALL JOINTS AND TO PROVIDE, INSTALL AND GROUT INLET AND OUTLET PIPES.
- CONTRACTOR TO TAKE APPROPRIATE MEASURES TO PROTECT SCREEN & SEPARATION CYLINDER COMPONENTS DURING INSTALLATION



PHONE: 1300 354 722

www.oceanprotect.com.au

OCEAN PROTECT
OCEANSAVE 0606 OFFLINE
SPECIFICATION DRAWING